


TITAN 1" DEFLECTION ISOLATOR
IP UNITS (INCHES AND POUNDS)

MFG. #01-30,112-00

TYPE	L	W	A	B	D	d	E	F	H	LL	T	TT
1-7600/14000	21.50	10.00	6.00	18.25	0.94	0.81	5.50	7.81	9.03	14.00	0.94	0.63

*ALL MOUNTING BOLT PATTERNS SYMMETRICAL ABOUT ISOLATOR CENTER-LINE

STANDARD RATINGS		SPRING COIL					
		COLOR		FREE		RATED	
TYPE	SIZE	OUTER	INNER	HT.	O.D.	LOAD	DEFL.
TITAN (A)	1-7600	RED	BROWN	4.20	3.00	7600	1.00
TITAN (A)	1-8800	ORANGE	GRAY	4.20	3.00	8800	1.00
TITAN (A)	1-9860	BLUE		4.20	3.00	9860	1.00
TITAN (A)	1-10680	BLUE	BROWN	4.20	3.00	10680	1.00
TITAN (A)	1-11460	BLUE	GRAY	4.20	3.00	11460	1.00
TITAN (A)	1-12260	BLUE	CHROME	4.20	3.00	12260	1.00
TITAN (A)	1-14000	BLUE	BROWN	4.20	3.00	14000	1.00

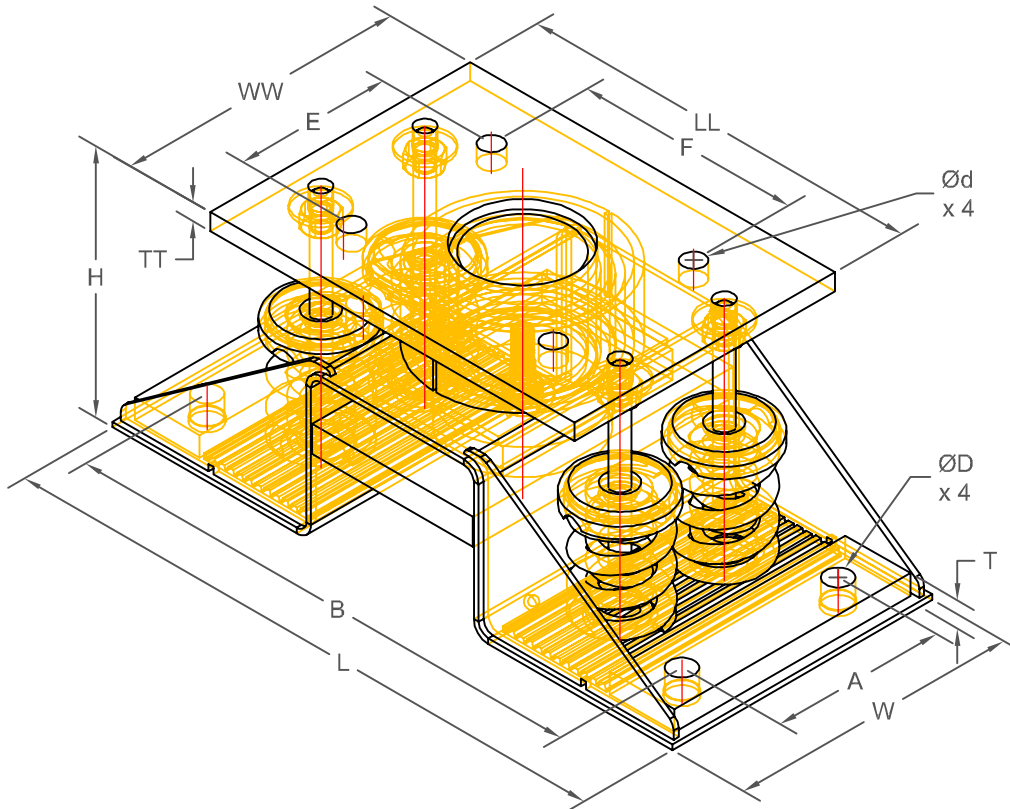


SPECIFICATIONS

- * VERTICALLY AND LATERALLY RESTRAINED SPRING ISOLATOR.
- * CONSTANT FREE AND OPERATING HEIGHT.
- * FIELD REPLACEABLE RUBBER ELEMENTS
- * MIN OVERLOAD OF 50%.
- * MIN K_x/K_y RATIO OF 1.0.
- * ALL ELEMENTS SAFE AT SOLID LOADING.
- * POWDER COATED SPRING COILS.
- * HOUSINGS ARE HOT DIP GALVANIZED.
- * HARDWARE IS ZINC PLATED.
- * TOTAL COMBINED LATERAL AND VERTICAL MOVEMENT IS LIMITED TO 1/2" (1/4" IN ANY DIRECTION).

NOTE:
CURRENT CODE REQUIREMENTS CALL FOR ANCHORS TO BE EVALUATED ON A CASE SPECIFIC BASIS. BUILDING CODE, ANCHOR TYPE AND INSTALLATION CONDITIONS ALL IMPACT THE CAPACITY. FOR APPLICATIONS CERTIFIED BY KNC, THIS EVALUATION WILL BE PERFORMED BY KNC. FOR APPLICATIONS CERTIFIED BY OTHERS, IT IS RECOMMENDED THAT THE DESIGNER USE THE APPROPRIATE ANCHOR MANUFACTURER'S ANALYSIS SOFTWARE.

WITH THE USE OF CONCRETE ANCHORS AND AN APPROPRIATE OVERSIZED BASEPLATE, THE MAXIMUM RESTRAINT RATING OF THIS ISOLATOR CAN BE INCREASED AS HIGH AS THE LEVEL FOR WELDED/BOLTED CONNECTIONS INDICATED ON THIS CURVE.

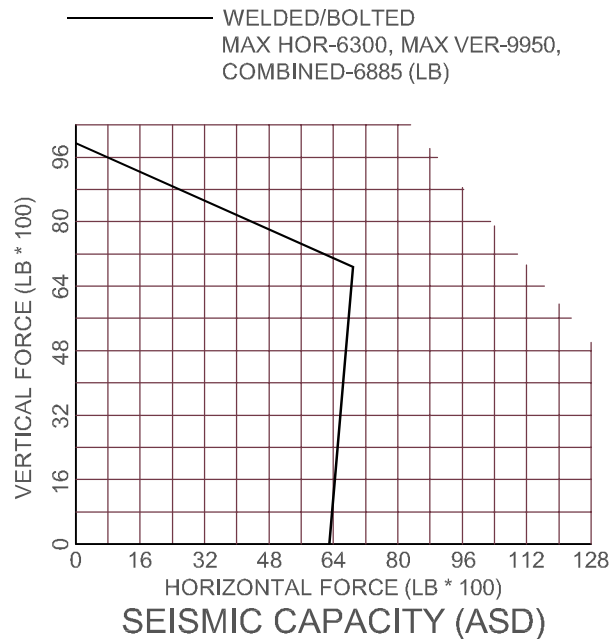

Drawing No: S-01.30-13A
By: PWM
Date: 04/17/13
Revised: 2/22/17 / JW

Model: TITAN (A)
1-7600/14000

KINETICS NOISE CONTROL, INC
6300 IRELAN PL,
DUBLIN, OH 43017 USA
Ph: 614 889-0480, Fax: 614 889-0540
www.kineticsnoise.com

